







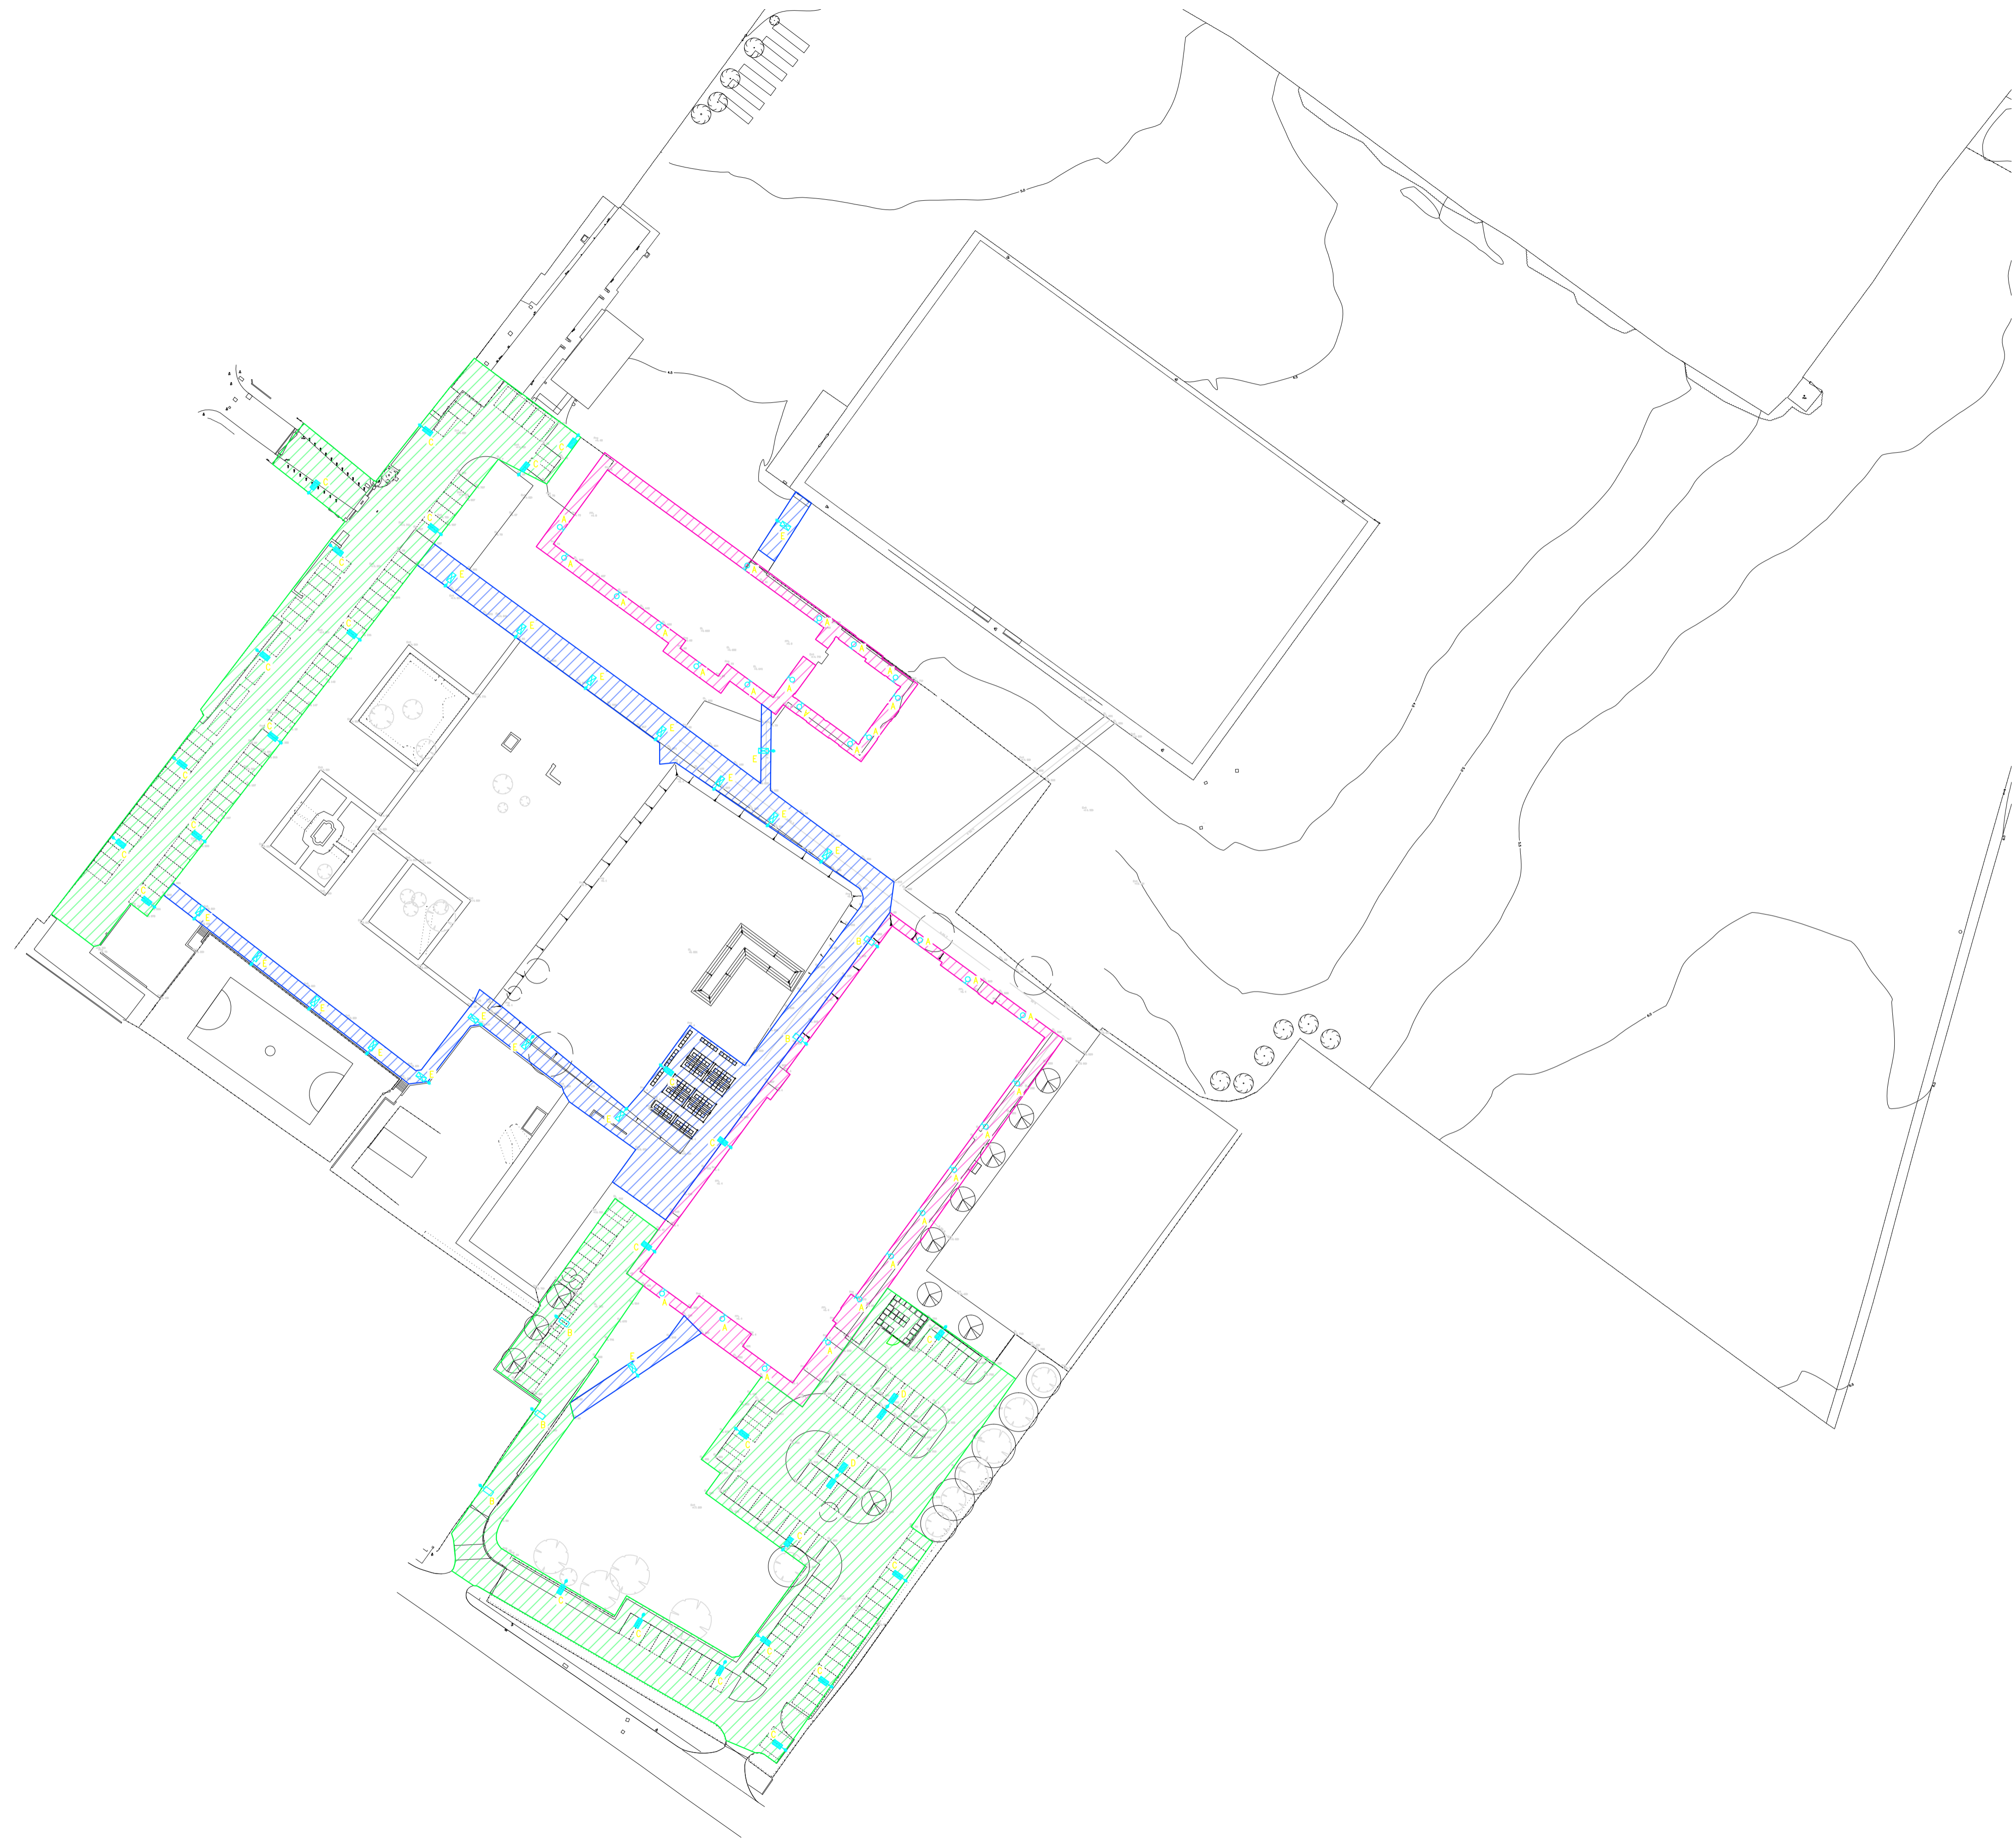


-  CAR PARK & ENTRANCE
AVERAGE LIGHTING LEVEL
12lux, 0.25 UNIFORMITY AVE/MIN.
-  PEDESTRIAN WALKWAY
AVERAGE LIGHTING LEVEL
10lux, 0.25 UNIFORMITY AVE/MIN.
-  PERIMETER OF BUILDING
AVERAGE LIGHTING LEVEL
10lux, 0.4 UNIFORMITY AVE/MIN.

SYMBOLS LEGEND	
SYMBOL	DESCRIPTION
	DOWNER WALL ELITE WALL MOUNTED AT 2.8m DEW 2024 LED C 2000lm, 400k
	FACTOR SMALL STREET LIGHT SINGLE HEAD COLUMN MOUNTED AT 5m FTS.L064AY LED C 6000lm 4000k
	FACTOR SMALL STREET LIGHT SINGLE HEAD COLUMN AT 5m FTS.L074AY, LED C 7000lm 4000k
	FACTOR SMALL STREET LIGHT TWIN HEAD COLUMN AT 5m FTS.L074AY, LED C 7000lm 4000k
	FACTOR SMALL STREET LIGHT SINGLE HEAD COLUMN AT 5m FTS.L034AY, LED C 3000lm 4000k



Project: CASTLE COMMUNITY COLLEGE KENT PSBP
 Drawing Title: SITE WIDE - EXTERNAL LIGHTING STRATEGY
 Document Ref: 16-12001-99-SW-01 Rev. P1
 Date: 25.06.2015
 Scale: 1 : 500 @ A0